

# 270<sup>SERIES</sup>


## SYNCHRONOUS ALTERNATORS

4 POLE 50/60 Hz - THREE PHASE

# GENPOWER<sup>®</sup>

ALTERNATOR

## General Information

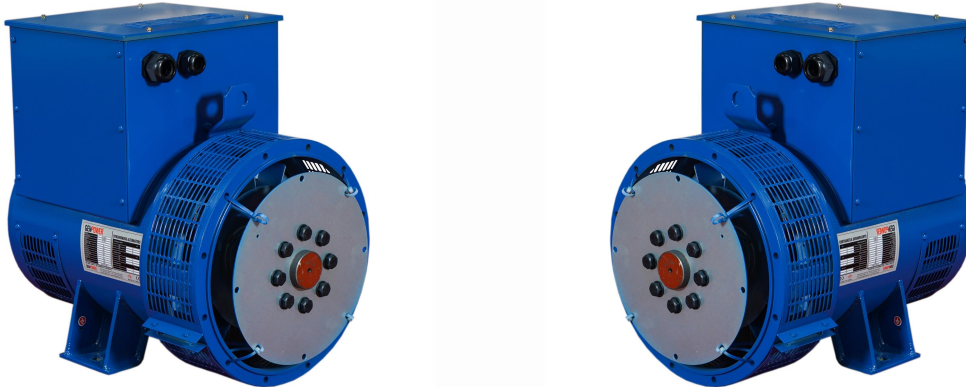

STANDARD SPECIFICATIONS

### General Specifications

Genpower, is an independent and internationally recognized power producer, specializing exclusively on manufacturing of synchronous alternators.

Genpower focuses its corporate mission on original and self-made designs; innovative solutions and provide long-term and sustainable development.

Turkish and foreign technical teams are always working with their knowhow and experience in order to meet universal demands and projects and to have a continuous increase in the performance, total lifespan and overall reliability of the products. Genpower continues the R&D studies with universities both in Turkey and in other countries who have comprehensive knowledge on its products.

Genpower synchronous alternators are proven to endure the harshest environmental applications. They proved to be one of the most reliable and preferred alternator brands all over the world with their brushless and self-exciting system, electronic voltage regulator (AVR), stable wave form, low harmonic distortion and high efficiency.

In case of a demand, Genpower can also produce direct current (DC) alternators, 50-60 Hz low voltage (LV) alternators, medium voltage alternators, high voltage alternators; alternators for light towers, welding alternators, IP44 and PI54 class alternators for marine applications, variable speed alternators for telecom projects and cranes; high frequency alternators for ground power units, radars, planes and helicopters.

### Product Application

Genpower alternators are mainly used in the application of diesel, gasoline and gas generator groups. They are also able to operate with steam or hydraulic turbines. They operate in all configurations of emergency generator groups, power plants or continuous power sources.

- Industrial and commercial complex.
- Telecommunication and cell-phone towers, radio and television transmitters
- Defense industry and military projects.
- Construction sites, mining, stone crushers and mixing plants, light towers
- Agriculture and irrigation; cattle and chicken farms
- Hotels and hospitals, lofts, care centers, clinics
- Offices, shops, factories, workshops, buildings, sports complexes, stores, malls, banks, gas stations
- Rental companies, mobile service vehicles, mobile hospitals, and other mobile facilities
- Airports, initial starting of the air vehicles, ground services

### Standards

Genpower synchronous alternators are designed and manufactured in compliance with TSE 60034-1; IEC 60034-22; GB755; BS4999-5000; NEMA MG 1.22 CE marking approved and are also accredited with ISO 9001:2008 and ISO 14001:2004.

TECHNICAL SPECIFICATIONS



ISO 9001:2008  
OHSAS 18001:2007  
ISO 14001:2004



# 270 SERIES

## SYNCHRONOUS ALTERNATORS

4 POLE 50/60 Hz - THREE PHASE



### General Information

#### Construction

Genpower alternators are made according to the requirements of the standard TSE 60034-1; IEC 60034-1. Using the best quality standards during manufacturing, the result is safe operation and great durability. Mounting styles normally supplied are; Single bearing with coupling by means of flanges and flexible disc. Double bearing with coupling by means of flange.

#### Winding & Electrical Performance

All alternators stators windings are 2/3 pitch. This eliminates triple (3rd, 9th, 15th ...) harmonics on the voltage waveform and is found to be the optimum design for trouble-free supply of non-linear loads. The 2/3 pitch design avoids excessive neutral currents sometimes seen with higher winding pitches, when in parallel with the mains. A fully connected damper winding reduces oscillations during paralleling. This winding, with the 2/3 pitch and carefully selected pole and tooth designs, ensures very low waveform distortion.

High quality siliceous metals are used in the body and it increases the efficiency of the alternator.

#### Excitation System & Automatic Voltage Regulators (AVR)




The self-warming control system supplies power from the main stator to the warning stator via AVR. The high efficiency semiconductors of AVR (diodes transmitters, etc.) allow the low permanent voltage to be positively raised. Three-phase excitation rotor diode bridge output supplies the main rotor excitation area. There is a varistor that protects the diode bridge and acts as a plug from shocks that may be short-circuited or similar.

With the Frequency / Voltage ratio (U / F) system, it protects AVR and alternator against low frequency.

It provides voltage adjustment opportunity within  $\pm 5\%$  limits for external voltage adjustment.

Automatic Voltage Regulators (AVR) are specially designed and catered for both single and parallel running operations for both self-excited and separately excited system (PMG).

STANDARD SPECIFICATIONS

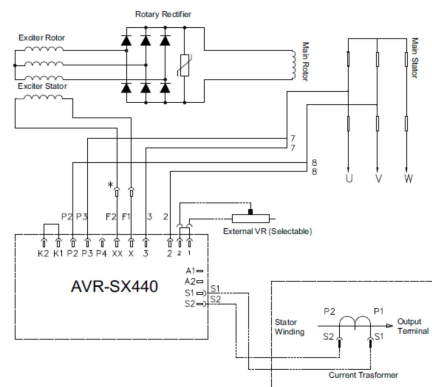

TECHNICAL SPECIFICATIONS

## General Information

### Terminal & Terminal Box

Standard generators are 3-phase reconnect able with 12 ends brought out to the terminals, which are mounted on a cover at the non-drive end of the generator. A sheet steel terminal box contains the AVR and provides ample space for the customers' wiring and gland arrangements. It has removable panels for easy access.

### Insulation / Impregnation (VPI)

The insulation system is class H. All winding components are impregnated in an unsaturated polyester resin of 200 class temperature. The impregnation provides much needed rigidity and protection against the harsh environment, typical for the generators applications. Genpower alternators are delivered with Genpower insulation system. This insulation system is based on the "Vacuum Pressure Impregnation" (VPI) system which was developed in cooperation with the most renowned suppliers of insulation material all over the world. Using special epoxy based resin; this insulation system ensures perfect winding insulation of the alternators and does not emit harmful gases into the environment.

### Dynamic Balancing

The rotating (Main rotor, exciter rotor, diode group, fan) parts are dynamically balanced with greater precision than that required by the Standard TSE EN IEC 60034-14 and ISO2372, ensuring minimum levels of residual unbalance.

### Waveforms / Radio Interference

The alternators are designed to give an excellent output waveform. The total harmonic content of line voltage waveform on no load is less than 5% as per limits specified by TSE / IEC Standards.

The Alternators are having negligible Radio Frequency Interference and meets the general limits permitted by VDE 0875 (N). TIF value is <50 and THF value is <2%.

### Transient Ratings

Transient voltage drop due to application of full load at 0.8 power factor is less than 18% output voltage recovers to within 3% of the rated value in less than 0.3 seconds.

### Continuous Duty / S1 – Ambient Temperature / 40°C

The alternator operates at rated power for an unlimited time with the possibility of overload up to 10% for 1 hour every 12 hours, without damage to its insulation system. The S1, also called continuous or prime duty is applied mainly where there is not another power source available, such as; groups for rental groups for irrigation, refrigeration and application for peak hours. For continuous duty, it is accepted a temperature raise in the windings of up to 125°C.

### Standby Duty – Ambient Temperature / 40°C

The generator group operates as energy backup with variable loads in emergency situations in places supplied by the grid / utility company or another main power source. In this kind of duty, the machine does not accept overloads and operates with variable loads up to the rated power of the stand-by duty (40°C). A raise in the winding temperature of up to 150°C is accepted (as per Standard of TSE 60034 / IEC 60034), However if that happens the useful life of the alternator reduces 2 to 6 times. The use of the alternator in stand-by duty is limited to 500 hours a year.

### Operating Conditions

When choosing an alternator, "ALTITUDE", "AMBIENT TEMPERATURE" and "POWER FACTOR" should be taken into consideration. Power drops should be calculated with the help of the table below and power determination should be done accordingly.

## General Information

### Altitude

The rated power refers to installations up to 1000 meter above sea level. For applications over this altitude, the following power correction factor must be applied.

Altitude (m)	<1000	<1500	<2000	<2500	<3000
K Factor	1	0.96	0.93	0.90	0.86

### Power Factor ( Cos Q)

The nominal power factor is 0.8 lagging. For application with power factor value different from 0.8, the following correction factor must be applied.

Power Factor (CosQ)	0.80	0.70	0.60	0.50	0.30	0
K Factor	1	0.93	0.88	0.84	0.82	0.80

### Temperature Rise

Temperature rise is the increase in temperature above ambient temperature 40°C ratings.

Temperature Rise	Temperature °C
B	80°C
F	105°C
H	125°C

### Generator Set Ratings

The tables below summarize the definitions accordance to TSE 8528-1 / ISO 8528-1 for the generator set and a combination of TSE 8528-3 / ISO 8528-3 and TSE 60034-1 / IEC 60034-1 for the alternator.

Genset Rating TSE 8528-1	Emergency Standby Power (ESP)	Limited Time Prime Power (LTP)	Prime Rated Power (PRP)	Continuous Operating Power (COP)
Load Type	Variable	Constant	Variable	Constant
Annual Operating Hors	200	500	Unlimited	Unlimited
Average Load	70%	100%	70%	100%
Overload	No	No	10% 1 Hour in every 12	No
Alternator Rating	Standby	Standby	Continuous	Continuous
Duty Cycle	S10	S10	S1	S1
Alternator Ratings	Standby 150/40°C	Standby 150/40°C	Class H 125/40°	Class H 125/40°
	Standby 163/27°C	Standby 163/27°C	Class F 105/40°C	Class F 105/40°C

### Ambient Temperature

The rated powers refer to installation with ambient temperature of 40°C. For applications different from 40°C, the following power correction factor must be applied.

Ambient Temperature	30°C	35°C	40°C	45°C	50°C	55°C
K Factor	1.04	1.02	1	0.96	0.93	0.90

### Thermal Insulation Class

Insulation class governs the maximum permissible temperature an alternator can operate without damaging the insulation system.

Insulation Class	Maximum Permissible Temperature
F	155°C
H	180°C

Stand-by application allows windings to run hotter than the class H temperature rise limit, therefore for an ambient of;

**40°C Temperature Rise : 150°C**

**27°C Temperature Rise : 163°C**

# 270<sup>SERIES</sup> SYNCHRONOUS ALTERNATORS

4 POLE 50/60 Hz - THREE PHASE

# GENPOWER<sup>®</sup>

ALTERNATOR

## 400V – 50 Hz

### Alternator Technical Data – 50Hz

#### 4 POLE 1500 RPM 50 Hz

##### TYPICAL DATA

Insulation class	H	Control system	Self excited
Winding pitch	2/3 - (N° 6)	A.V.R. model (*)	Standard SX460 / SX440
Wires	12	Voltage regulation	± 1.0 %
Drip proof	IP 23	Sustained short-circuit current	300% (3 IN) : 10s
Altitude	≤ 1000 m	Total harmonic (**) TGH / THC	< 4 %
Overspeed	2250 min-1	Wave form: NEMA = TIF - (*)	< 50
Air flow	0.514 m³/sec.	Wave form: I.E.C. = THF - (*)	< 2 %
Bearing drive	-	Bearing non-drive	6310 - 2RZ

(\*\*) Total harmonic content line to line, at no load or full rated linear and balanced load

(\*) AVR model: Genpower uses AS440 AVR in 270LX and 270LXA alternators as Standard, SX460 AVR in other 270 model alternators.

#### 50 Hz kVA / kW – Power Factor (CosQ) = 0,8

Duty/Ambient C°	Continuous / 40°C			Stand-by / 27°C		
	H / 125° K			H / 163° K		
Class/C° rise						
Series Star (V)	380/220	400/231	415/240	380/220	400/231	415/240
Parallel Star (V)	190/110	200/115	208/120	190/110	200/115	208/120
Series Delta (V)	220	230	240	220	230	240
GNP 270 S	kVA	123	123	125	135	135
	kW	98	98	100	108	108
GNP 270 S1	kVA	141	141	144	155	155
	kW	113	113	115	124	124
GNP 270 S2	kVA	159	159	162	175	175
	kW	127	127	130	140	140
GNP 270 M	kVA	182	182	186	200	200
	kW	146	146	149	160	160
GNP 270 M1	kVA	214	214	218	235	235
	kW	171	171	174	188	188
GNP 270 MX	kVA	232	232	237	255	255
	kW	186	186	190	204	204
GNP 270 L1	kVA	255	255	260	280	280
	kW	204	204	208	224	224
GNP 270 LX	kVA	273	273	278	300	300
	kW	218	218	222	240	240
GNP 270 LXA	kVA	318	318	324	350	350
	kW	254	254	259	280	280

#### REACTANCES (%) – TIME CONSTANTS (ms) : CLASS: H / 400 V

VOLTAGE SERIAL STAR	400 V	270 S	270 S1	270 S2	270 M	270 M1	270 MX	270 L1	270 LX	270 LXA
DIR. AXIS SYNCHRONOUS	Xd	2,21	2,06	2,09	2,11	2,01	2,01	2,009	1,92	1,915
DIR. AXIS TRANSIENT	X'd	0,18	0,18	0,185	0,19	0,175	0,174	0,17	0,17	0,168
DIR. AXIS SUBTRANSIENT	X" d	0,13	0,11	0,12	0,13	0,12	0,12	0,12	0,12	0,118
QUAD. AXIS REACTANCE	Xq	1,43	1,32	1,35	1,38	1,23	1,21	1,18	1,15	1,14
QUAD. AXIS SUBTRANSIENT	X" q	0,16	0,16	0,16	0,16	0,14	0,145	0,15	0,16	0,155
LEAKAGE REACTANCE	XL	0,06	0,06	0,07	0,08	0,08	0,083	0,078	0,07	0,06
NEGATIVE SEQUENCE	X2	0,14	0,13	0,135	0,14	0,12	0,125	0,123	0,12	0,14
ZERO SEQUENCE	X0	0,09	0,08	0,085	0,09	0,08	0,08	0,075	0,07	0,1
OTHER DATA – CLASS H / 400 V										
T'd TRANSIENT TIME CONST.		0,028 s	0,031 s	0,0315 s	0,032 s	0,034 s	0,035 s	0,038 s	0,038 s	0,03 s
T'd SUB-TRANSTIME CONST.		0,001 s	0,01 s	0,01 s	0,01 s	0,011 s	0,011 s	0,012 s	0,012 s	0,0085
T'do O.C. FIELD TIME CONST.		0,85 s	0,85 s	0,85 s	0,85 s	0,88 s	0,9 s	0,95 s	1 s	1 s
Ta ARMATURE TIME CONST.		0,007 s	0,0073 s	0,0072 s	0,007 s	0,0085	0,009 s	0,01 s	0,01 s	0,01 s
SHORT CIRCUIT RATIO		1/Xd	1/Xd	1/Xd	1/Xd	1/Xd	1/Xd	1/Xd	1/Xd	1/Xd

STANDARD SPECIFICATIONS

TECHNICAL SPECIFICATIONS



ISO 9001:2008  
OHSAS 18001:2007  
ISO 14001:2004



# 270 SERIES

## SYNCHRONOUS ALTERNATORS

4 POLE 50/60 Hz - THREE PHASE












# GENPOWER<sup>®</sup>

## ALTERNATOR

### 400V – 50 Hz

### 3 Phase / 400V / 50 Hz Efficiency Curves & Percent Transient Voltage Dip & Alternator Windings

STANDARD SPECIFICATIONS

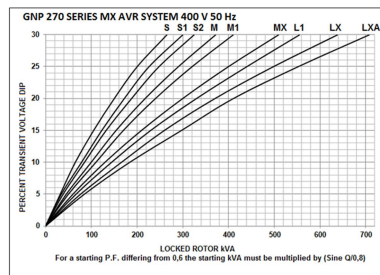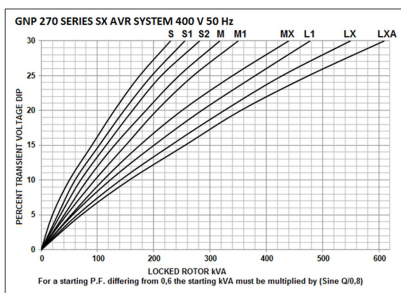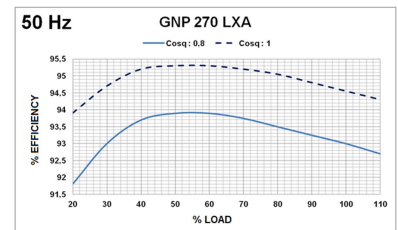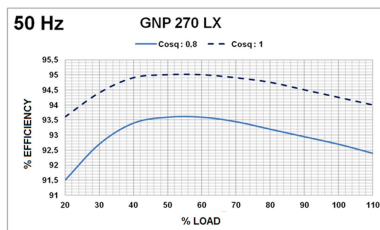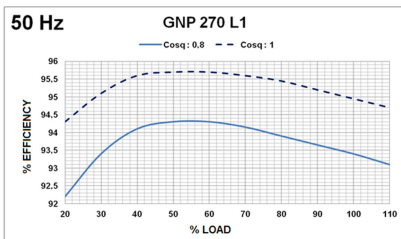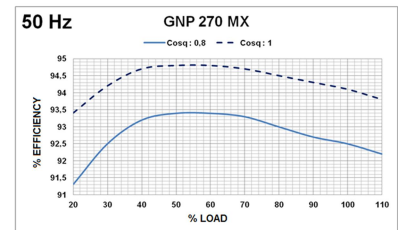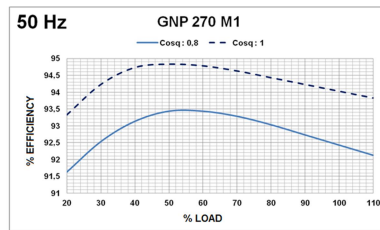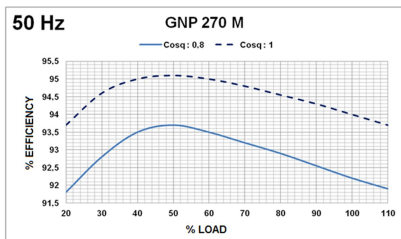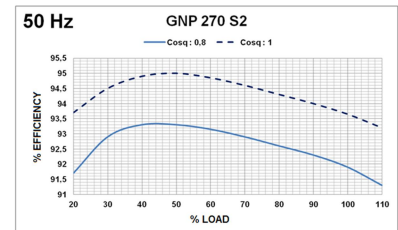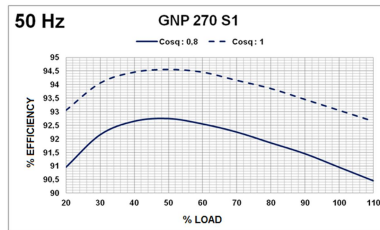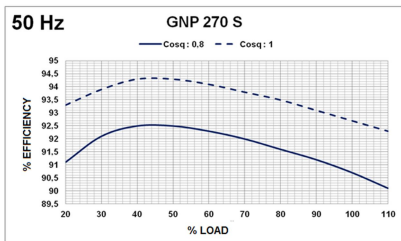

ALTERNATOR WINDINGS							
4 Pole	50 Hz - 1500 R.P.M						
Phase	3	3	3	3	1	1	1
Connections							
Number of Leads	6	6	12	12	12	12	12
Standard Winding	300-400-415V	220-240V	300-400-415V	220-240V	100-200V	220-240V	220-240V

TECHNICAL SPECIFICATIONS

High quality 100% copper wires are used in the rotors, stators and excitation wirings of GENPOWER alternators. All metal sheets used in the production are siliceous metals. Therefore, GNP alternators have higher efficiency compared to exemplary products.

**480V – 60 Hz**

**Alternator Technical Data – 60Hz**

**4 POLE 1800 RPM 60 Hz**

**TYPICAL DATA**

Insulation class	H	Control system	Self excited
Winding pitch	2/3 - (N° 6)	A.V.R. model (*)	Standard SX460 / SX440
Wires	12	Voltage regulation	± 1.0 %
Drip proof	IP 23	Sustained short-circuit current	300% (3 IN) : 10s
Altitude	≤ 1000 m	Total harmonic (**) TGH / THC	< 5 %
Overspeed	2250 min-1	Wave form: NEMA = TIF - (*)	< 50
Air flow	0.617 m³/sec.	Wave form: I.E.C. = THF - (*)	< 2 %
Bearing drive	-	Bearing non-drive	6310 - 2RZ

(\*\*) Total harmonic content line to line, at no load or full rated linear and balanced load

(\*) AVR model: Genpower uses AS440 AVR in 270LX and 270LXA alternators as Standard, SX460 AVR in other 270 model alternators.

**60 Hz kVA / kW – Power Factor (CosQ) = 0,8**

Duty/Ambient C°	Continuous / 40°C			Stand-by / 27°C		
	H / 125° K			H / 163° K		
Class/C° rise						
Series Star (V)	380/220	400/231	415/240	380/220	400/231	415/240
Parallel Star (V)	190/110	200/115	208/120	190/110	200/115	208/120
Series Delta (V)	220	230	240	220	230	240
GNP 270 S	kVA	139	146	154	153	161
	kW	111	117	123	122	129
GNP 270 S1	kVA	164	172	181	180	189
	kW	131	138	145	144	151
GNP 270 S2	kVA	184	194	204	202	213
	kW	147	155	163	162	170
GNP 270 M	kVA	210	221	233	231	243
	kW	168	177	186	185	194
GNP 270 M1	kVA	249	262	275	274	288
	kW	199	210	220	219	230
GNP 270 MX	kVA	269	284	298	296	312
	kW	215	227	238	237	250
GNP 270 L1	kVA	294	309	325	323	340
	kW	235	247	260	258	272
GNP 270 LX	kVA	321	338	356	353	372
	kW	257	270	285	282	298
GNP 270 LXA	kVA	358	377	398	394	415
	kW	286	302	318	315	332

**REACTANCES (%) – TIME CONSTANTS (ms) : CLASS: H / 480 V**

	480 V	270 S	270 S1	270 S2	270 M	270 M1	270 MX	270 L1	270 LX	270 LXA
VOLTAGE SERIAL STAR	Xd	2,3205	2,163	2,1945	2,2155	2,1105	2,1105	2,10945	2,016	2,01075
DIR. AXIS SYNCHRONOUS	X'd	0,189	0,189	0,19425	0,1995	0,18375	0,1827	0,1785	0,1785	0,1764
DIR. AXIS SUBTRANSIENT	X''d	0,1365	0,1155	0,126	0,1365	0,126	0,126	0,126	0,126	0,1239
QUAD. AXIS REACTANCE	Xq	1,5015	1,386	1,4175	1,449	1,2915	1,2705	1,239	1,2075	1,197
QUAD. AXIS SUBTRANSIENT	X''q	0,168	0,168	0,168	0,168	0,147	0,15225	0,1575	0,168	0,16275
LEAKAGE REACTANCE	XL	0,063	0,063	0,0735	0,084	0,084	0,08715	0,0819	0,0735	0,063
NEGATIVE SEQUENCE	X2	0,147	0,1365	0,14175	0,147	0,126	0,13125	0,12915	0,126	0,147
ZERO SEQUENCE	X0	0,0945	0,084	0,08925	0,0945	0,084	0,084	0,07875	0,0735	0,105
<b>OTHER DATA – CLASS H / 480 V</b>										
T'd TRANSIENT TIME CONST.		0,028 s	0,031 s	0,0315 s	0,032 s	0,034 s	0,035 s	0,038 s	0,038 s	0,03 s
T''d SUB-TRANSTIME CONST.		0,001 s	0,01 s	0,01 s	0,01 s	0,011 s	0,011 s	0,012 s	0,012 s	0,0085
T'do O.C. FIELD TIME CONST.		0,85 s	0,85 s	0,85 s	0,85 s	0,88 s	0,9 s	0,95 s	1 s	1 s
Ta ARMATURE TIME CONST.		0,007 s	0,0073 s	0,0072 s	0,007 s	0,0085	0,009 s	0,01 s	0,01 s	0,01 s
SHORT CIRCUIT RATIO		1/Xd	1/Xd	1/Xd	1/Xd	1/Xd	1/Xd	1/Xd	1/Xd	1/Xd

# 270 SERIES

## SYNCHRONOUS ALTERNATORS

4 POLE 50/60 Hz - THREE PHASE












# GENPOWER®

ALTERNATOR

## 480V – 60 Hz

### 3 Phase / 480V / 60 Hz Efficiency Curves & Percent Transient Voltage Dip & Alternator Windings

STANDARD SPECIFICATIONS

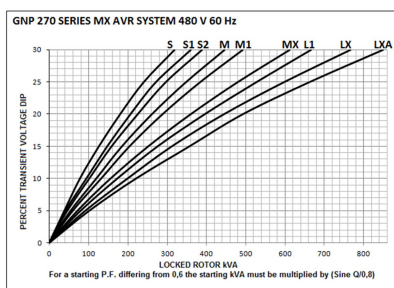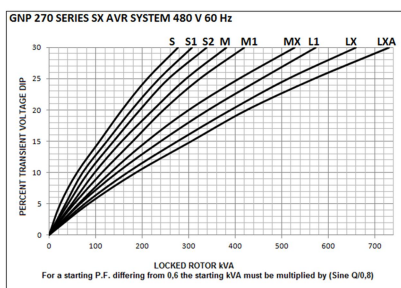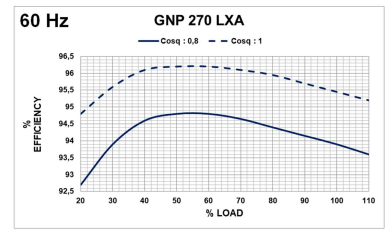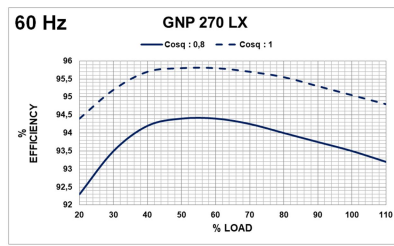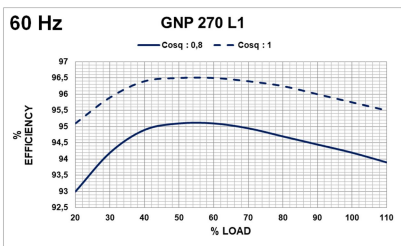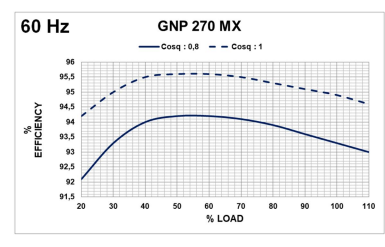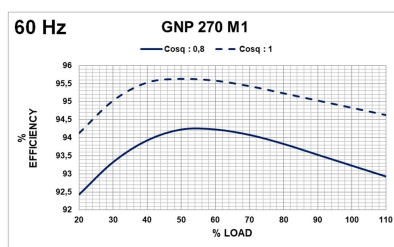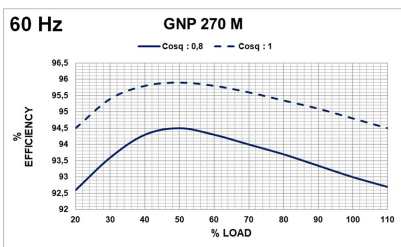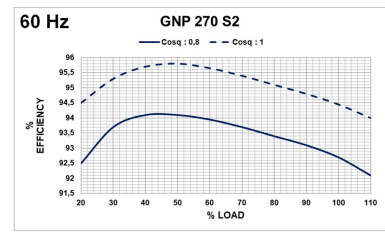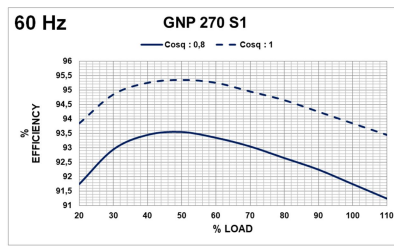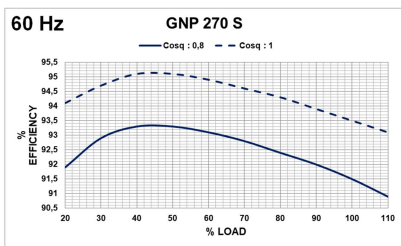

ALTERNATOR WINDINGS						
60 Hz - 1800 R.P.M						
4 Pole	3	3	3	3	1	1
Phase						
Connections						
Number of Leads	6	6	12	12	12	12
Standard Winding	380 - 480V	220 - 277V	380 - 480V	220 - 277V	190 - 240V	220 - 240V

TECHNICAL SPECIFICATIONS

High quality 100% copper wires are used in the rotors, stators and excitation wirings of GENPOWER alternators. All metal sheets used in the production are siliceous metals. Therefore, GNP alternators have higher efficiency compared to exemplary products.

# 270 SERIES

## SYNCHRONOUS ALTERNATORS

4 POLE 50/60 Hz - THREE PHASE


# GENPOWER®

ALTERNATOR

## Dimensions

### Dimensions

CONNECTION TYPE	SIZE					COUPLING DISC						
	SAE	GÖVDE	A	B	C	C of G	SAE	AN	AR	AS	AT	V
3	270 S-S1-S2	799	736	294	353	10	53,98	8	11	295,5	314,2	
	270 M	799	736	294	363							
	270 M1	914	851	409	378	11,5	39,68	8	11	333,3	352,3	
	270 M2	914	851	409	403							
	270 MX	964	901	459	423							
	270 L1-LX-LXA	1004	941	499	443							
FLANGE ADAPTER												
SAE	D	R	S	T	Y	W	X					
2	202	12	11	466,7	530	447,6	490					
3	202			428,6	530	409,5	451					

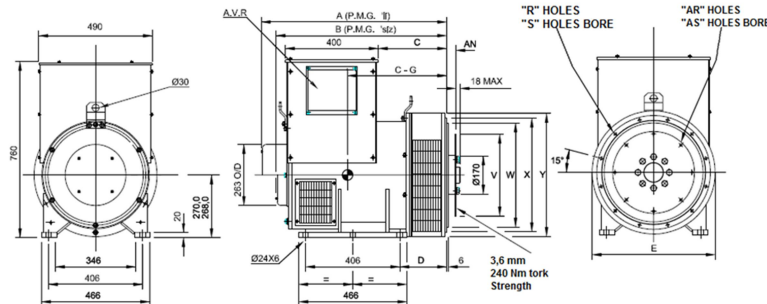

### Special Products / Non - Standardized

Light Tower Alternators  
Welding Alternators  
High Frequency Alternators  
Variable Speed Alternators

Direct Current Alternators - (DC)  
Medium Voltage Alternators - (MV)  
High Voltage Alternators - (HV)  
IP44 and IP54 Class Alternators - (Marine)

### Quality Documents & Certificates

Trademark Registration Certificate  
Capacity Report (32400 Units / Year)  
ISO 9001 - 2015 Certificate  
ISO 14001 - 2015 Certificate  
OHSAS 18001 - 2007 Certificate

Industrial Registry Certificate  
Certificate of Manufacturing Competence  
TSE- Service Adequacy Certificate  
TS EN 60034 - 1 Certificate

TSE – Turkish Standards Institution Certificate  
Certificate of Competency for After Sales Services  
Made in Turkey Certificate- For Generator/ 1 - 5000 kVA



# GENPOWER®

ALTERNATOR

**Factory Address**  
ASO II. Industrial Zone  
2010 Street No:18  
06909 Temelli-Sincan/Ankara, Turkey  
Tel/ Fax: +90(312) 641 32 22 - 641 32 32  
info@genpower.com.tr  
genpower@genpower.com.tr  
www.genpower.com.tr



ISO 9001:2008  
OHSAS 18001:2007  
ISO 14001:2004



GENPOWER RESERVES THE RIGHT TO CHANGE THE CATALOGUES, PRODUCTS, MODELS AND TECHNICAL SPECIFICATIONS

STANDARD SPECIFICATIONS

TECHNICAL SPECIFICATIONS